


CORE PLAN  
1/4" = 1'-0"


- NOTES:
- Ambulatory accessible compartment per 2020 FBC-A 604.8.2 door shall be self closing, have (1) pull at each side of door near latch and (1) coat hook at 42" A.F.F.
  - Paper towel & soap dispensers at Warming Kitchen shall be furnished by owner and installed by contractor.

MARK	DESCRIPTION	NOTES
GB	1 1/2" x 42" S/S UNIT - BOBRICK B6806	TOP @ 33" A.F.F.
GB-1	1 1/2" x 36" S/S UNIT - BOBRICK B6806	TOP @ 33" - 36" A.F.F. (5)
GB-2	1 1/2" x 18" S/S UNIT - BOBRICK B6806.99	TOP @ 33" ABOVE SHOWER FLOOR (6)
GB-3	1 1/2" x 60" S/S UNIT - NOTE #7	TOP @ 36" ABOVE SHOWER FLOOR 3 POINT BEARING (6)
SEAT	BOBRICK B5191	TOP AT 17" TO 19" ABOVE SHOWER FLOOR (8) (9) (10)
TB	36" LONG TOWEL BAR	TOP AT 47" A.F.F. - SELECTED BY OWNER
HOOK	BOBRICK B-672 (2 UNITS PER DOOR)	TOP AT 6'-0" A.F.F. (NON-ADA) & TOP AT 47" A.F.F. (ADA)
PTD	BOBRICK B3942	TOP @ 58" A.F.F. (SEMI-RECESSED UNIT).
PTD-1	BOBRICK B262	BOTTOM @ 40" A.F.F. MAXIMUM FOR H/C
SD	BOBRICK B5226 W/ 6" SPOUT	COUNTERTOP MOUNT
SD-1	BOBRICK B2112	BOTTOM AT 44" A.F.F. MAXIMUM FOR H/C
TPH	BOBRICK B2888	DOUBLE ROLL - HEIGHT PER ELEVATIONS
MIRROR	BOBRICK B290 - 18" WIDE X 36" HIGH	BOTTOM OF REFLECTING SURFACE @ 42" A.F.F.
MIRROR #1	BOBRICK B293 - 18" WIDE X 36" HIGH	BOTTOM OF REFLECTING SURFACE @ 39 1/2" A.F.F. FOR H/C
US	SEE NOTE #2 BELOW	18" DEEP
US-1	SEE NOTE #2 BELOW	24" DEEP
FND	BOBRICK B270	TOP AT MAXIMUM 28" A.F.F. FOR H/C
SCD	BOBRICK B221	TOP AT MAXIMUM 58" A.F.F. FOR H/C
TR	BOBRICK B532	COUNTERTOP TRASH RING

- TOILET ACCESSORY SCHEDULE NOTES:
- Equal substitutions are permitted. Submit shop drawings to Architect prior to construction.
  - Toilet partitions shall be Bobrick overhead braced units - #1081 series (solid phenolic). Urinal screens shall be Bobrick #1081 series - 18" & 24" deep X 42" high (post to wall at 24" deep unit). Doors shall be self closing and have (1) pull. Each stall shall have (1) coat hook with bumper.
  - Paper towel dispenser mounting:  
A) Adult - Outlet of dispenser shall be 15" - 48" A.F.F.
  - Furnish and install solid wood blocking for toilet accessories.
  - Grab bar installation shall allow water closet tank lid to be removed - (minimum 2" clear).
  - Maximum 6" from corner.
  - Ocelco Healthcare Equipment SKU #220-209.
  - Shower curtain & rod are N.I.C.




A2 BEVELED CHANGE IN LEVEL  
NO SCALE (AT SHOWER)

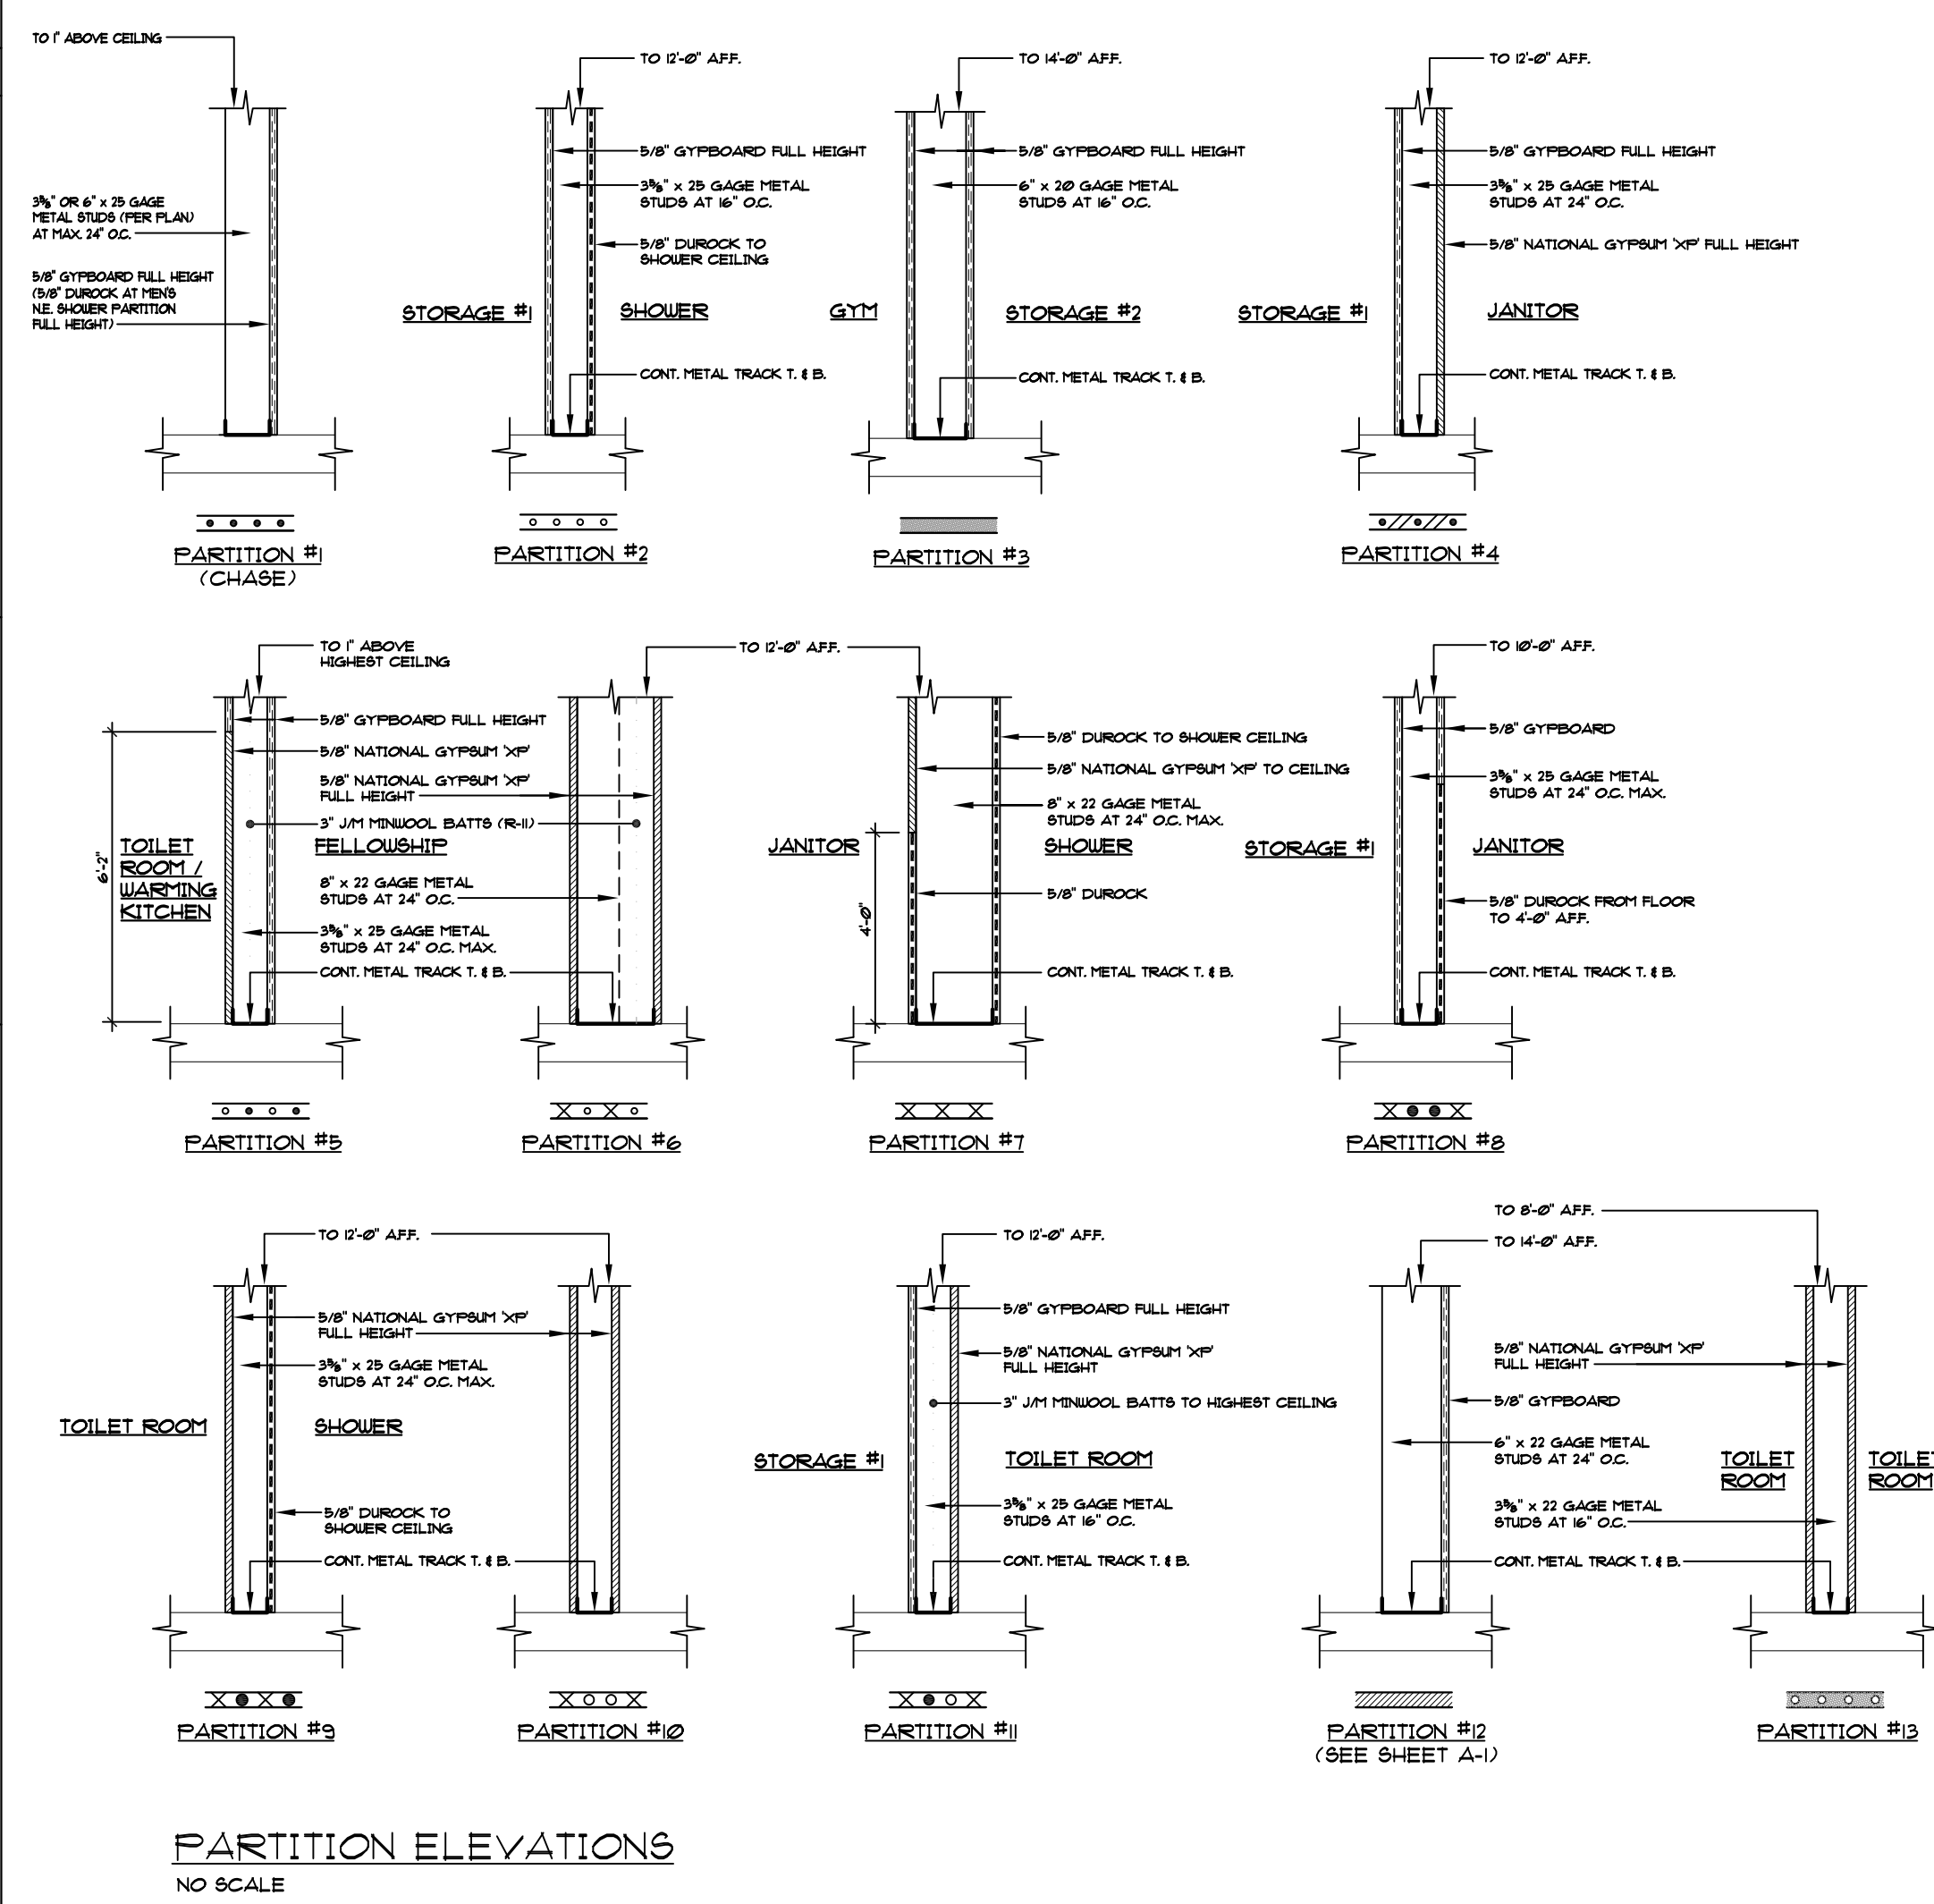

PARTITION ELEVATIONS  
NO SCALE

ROOM TITLE	FLOOR	BASE	WALLS		CEILING		HEIGHT	REMARKS
			MAT.	FINISH	MAT.	FINISH		
GYMNASIUM	CONCRETE (1)	VINYL (3)	CMU/GYPBD	FT (7) / MBP (8)	ROOF	—	VARIES	PAINT ALL STRUCTURAL STEEL (16)
GYM STORAGE #1	CONCRETE (1)	VINYL (3)	CMU/GYPBD	PAINT (7) (9)	ROOF	—	VARIES	PAINT ALL STRUCTURAL STEEL (16)
GYM STORAGE #2	CONCRETE (1)	VINYL (3)	CMU/GYPBD	PAINT (7) (9)	GYPBOARD (12)	PAINT (9)	14'-0"	
FELLOWSHIP AREA	TILE (2)	WOOD (4)	GYPBOARD	PAINT (9)	AC. TILE (13)	—	13'-8"	
WOMEN'S TOILET	TILE (2)	TILE (5)	GYPBOARD	PAINT (9)	AC. TILE (13)	—	9'-11"	WALL TILE WAINSCOT FLOOR TO 6'-2" AFF.
WOMEN'S SHOWER	TILE (2)	TILE (5)	GYPBOARD	TILE (10)	GYPBOARD (14)	PAINT (9)	9'-0"	
MEN'S TOILET	TILE (2)	TILE (5)	GYPBOARD	PAINT (9)	AC. TILE (13)	—	9'-11"	WALL TILE WAINSCOT FLOOR TO 6'-2" AFF.
MEN'S SHOWER	TILE (2)	TILE (5)	GYPBOARD	TILE (10)	GYPBOARD (14)	PAINT (9)	9'-0"	
WARMING KITCHEN	TILE (2)	TILE (6)	GYPBOARD	FRP (1)	AC. TILE (15)	PLASTIC	9'-11"	
JANITOR	CONCRETE (1)	VINYL (3)	GYPBOARD	FRP (1)	GYPBOARD (13)	PAINT (9)	10'-0"	

- ROOM FINISH SCHEDULE NOTES:
- Paint concrete floor slab - selected by contractor and owner.
  - Porcelain tile - selected by owner and contractor.
  - 6" high X 1/8" vinyl base (coils) with coved bottom.
  - Wood base shall be Smith & DeShields #BA714B (11/16" X 7 1/4"). Paint grade poplar (prime & paint).
  - 6" porcelain tile base with coved bottom and square top.
  - 6" high porcelain tile with coved top and bottom.
  - Interior paint at CUM shall be 1 coat Prep-rite Block filler and 2 coats Pro-Mar 200 Zero Voc Latex paint. Verify sheen with owner prior to construction.
  - MBP denotes insulated metal building panel finished at both faces.
  - Gypboard interior panel shall be coat Pro-Mar 200 Zero VOC latex primer and 2 coats of Promar 200 Zero VOC interior latex flat paint. All Toilet Room wall paint shall be Promar 200 Zero VOC interior latex egg-shell paint. Specifications refer to Sherwin Williams Paint Company. PPG is approved manufacturer. Submit cut sheets to Architect for review.
  - Wall porcelain tile - Selected by owner and contractor.
  - NUDO FRP liner panels (0.090") with joint strips from floor to ceiling at Janitor Closet & floor to 8'-0" A.F.F. at Warming Kitchen.
  - 3/8" gypboard on bottom and 3/4" plywood on top of 6" X 16 gage metal studs at 16" o.c. Frame southwest to northeast - non-load bearing (not designed for storage).
  - Acoustical tile ceiling shall be Armstrong #704 Cortega Angled Tegular Edge tiles (24" X 24") with white Prelude 'XL' 15/16" grid.
  - 3/4" National Gypsum 'XP' gypboard on bottom of 6" X 20 gage horizontal metal studs at 16" o.c.
  - 15/16" Prelude 'XL' grid (water repellent and washable tiles).
  - Paint all exposed structural steel with 2 coats of paint on touched up primer.
  - No tile behind cabinets.
  - Prepare all surfaces and install finish material per manufacturers written instructions.
  - Prepare slab prior to new flooring installation per manufacturer's written instructions. Subfloor shall be free of all adhesives, sealers, etc. to receive all finished flooring.
  - Finishes shall be Class 'B' at exits and exit accesses and Class 'C' at other spaces per 2020 FBC-B Table 803.5.
  - Wall and ceiling finishes shall be Class 'A' or 'B' at exits and exit accesses, with Class 'C' at other spaces per 2018 NFPA 101. Floor finishes shall be Class I or II at exits and exit accesses per 2018 NFPA 101.
  - All colors and sheens selected by owner from standard colors.
  - Furnish and install all material, accessories, and labor for a complete installation.
  - Finishes at Toilet Rooms conform to 2020 FBC-B 1210.2 for surrounding materials.
  - Furnish A.D.A. approved transition strips between dissimilar flooring & elevation changes.
  - Furnish 2% extra stock of all materials for owner's use.
  - Gypboard shall be finished to Level 4.
  - Materials selected by owner and contractor per construction contract.
  - NO CHINESE GYPBOARD PERMITTED.

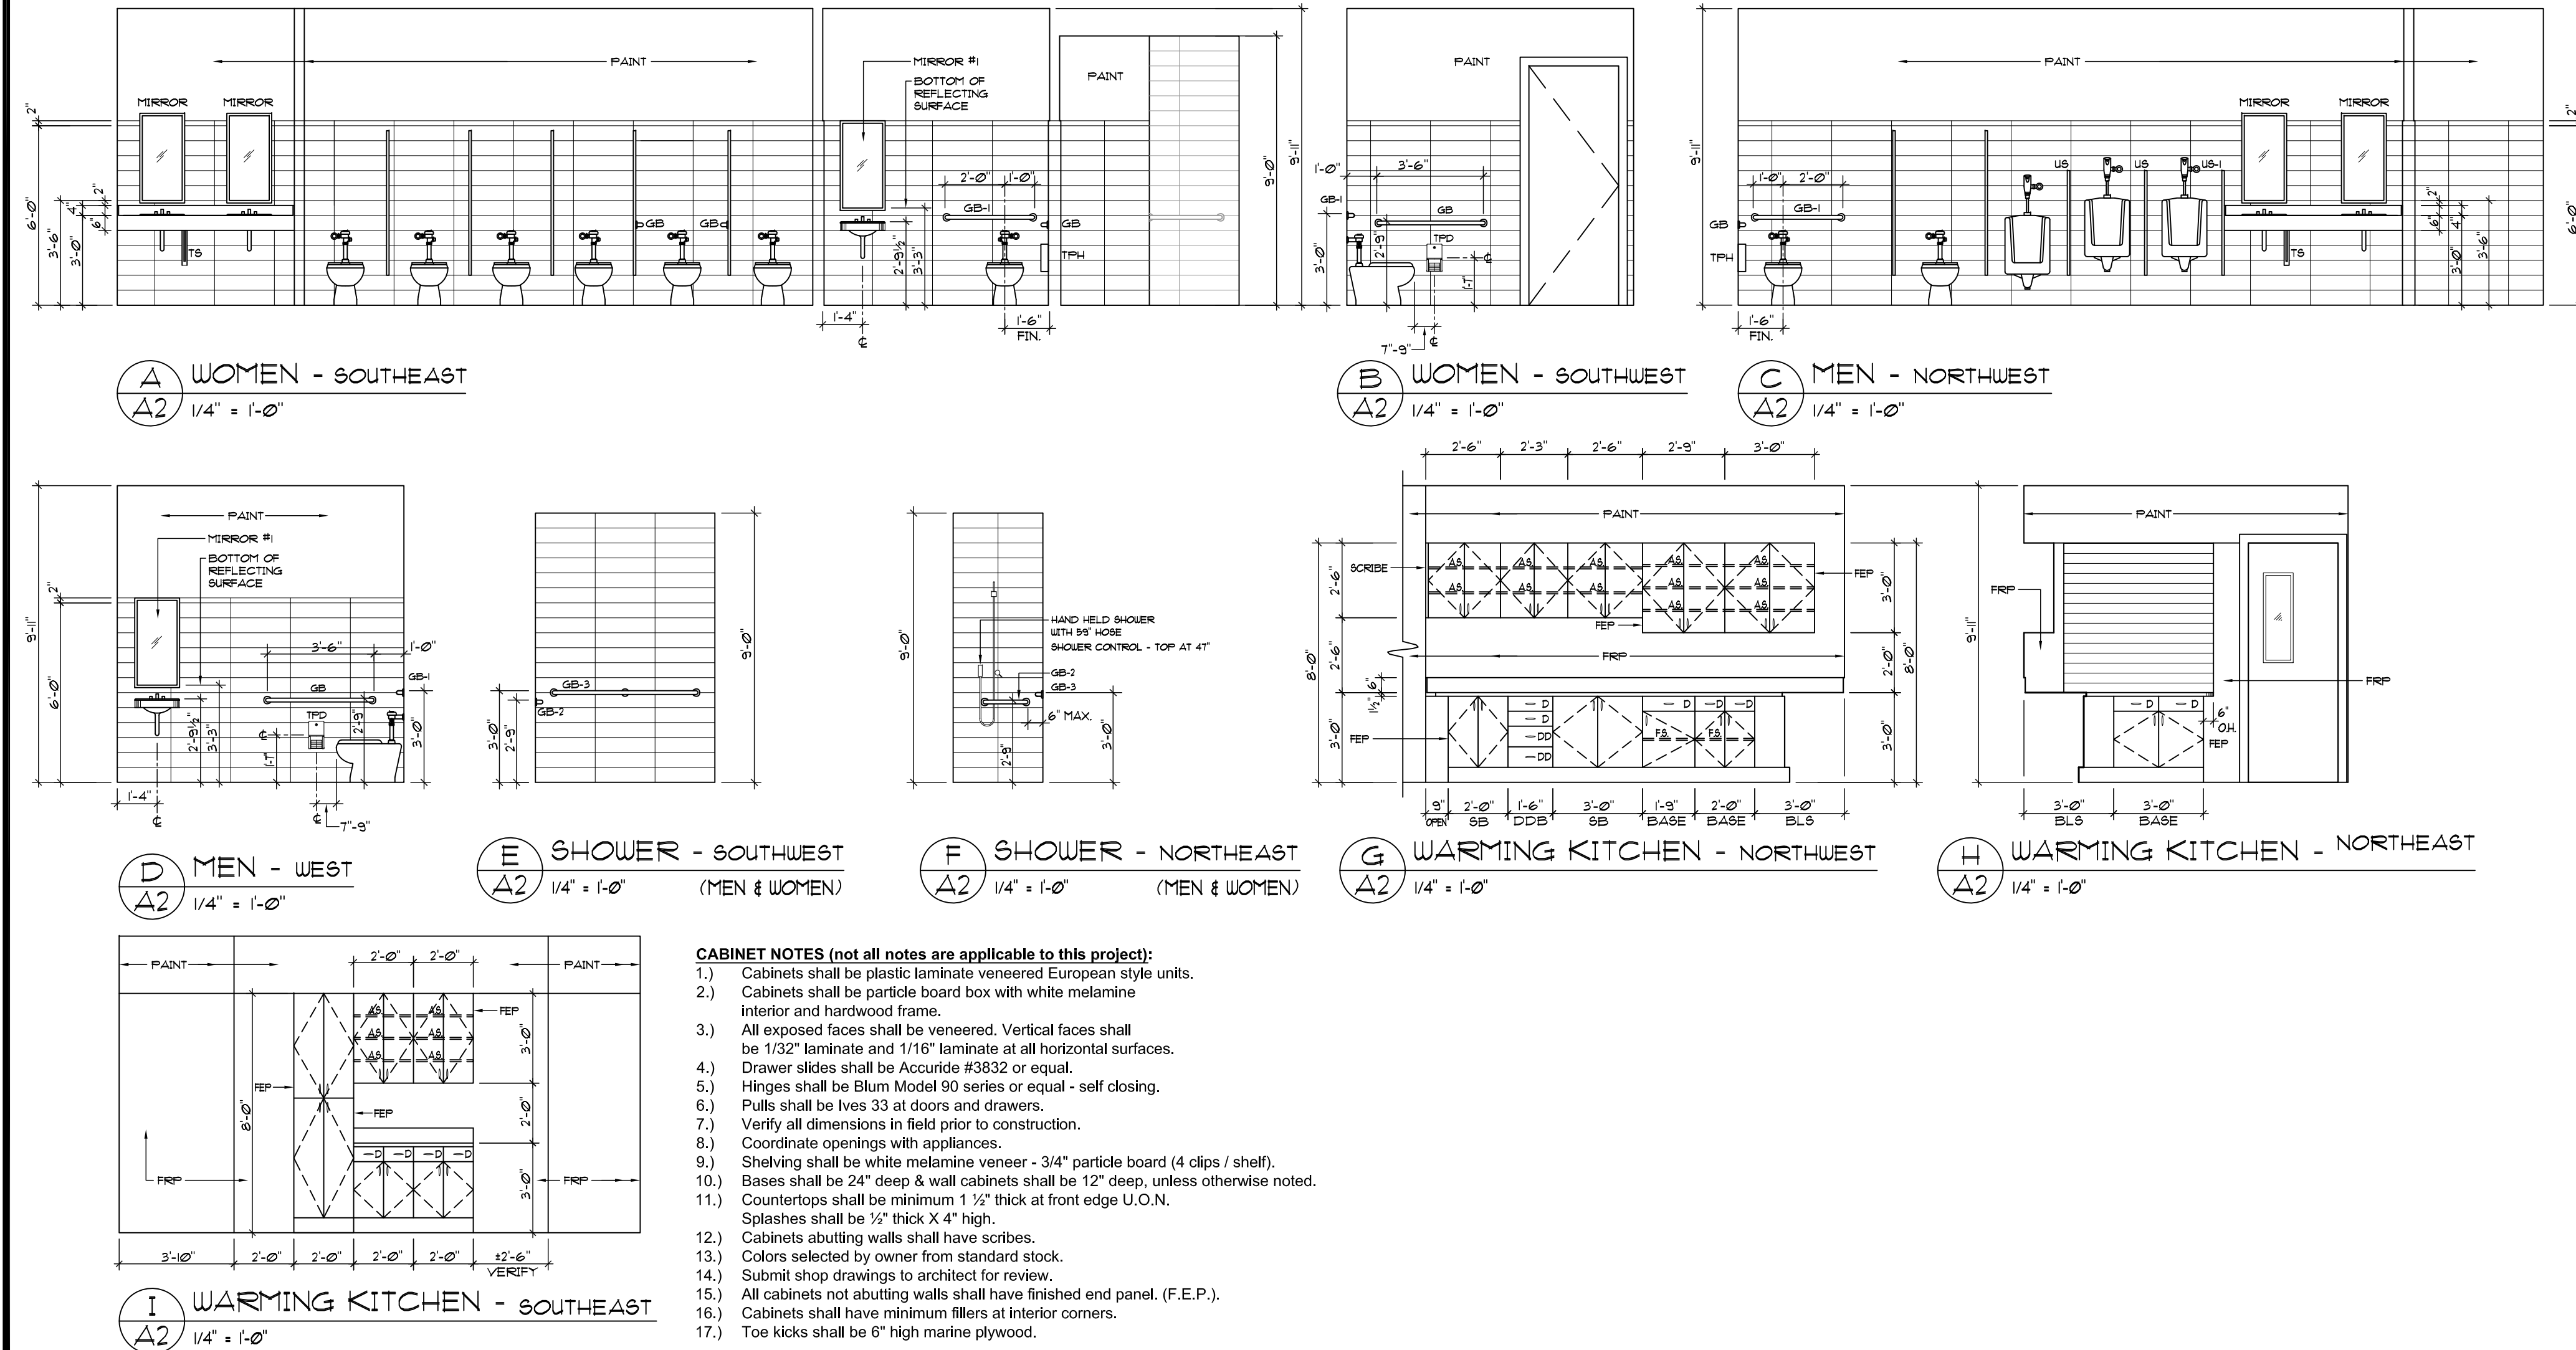

- CABINET NOTES (not all notes are applicable to this project):
- Cabinets shall be plastic laminate veneered European style units.
  - Cabinets shall be particle board box with white melamine interior and hardwood frame.
  - All exposed faces shall be veneered. Vertical faces shall be 1/32" laminate and 1/16" laminate at all horizontal surfaces.
  - Drawer slides shall be Accuride #3832 or equal.
  - Hinges shall be Blum Model 90 series or equal - self closing.
  - Pulls shall be Ives 33 at doors and drawers.
  - Verify all dimensions in field prior to construction.
  - Coordinate openings with appliances.
  - Shelving shall be white melamine veneer - 3/4" particle board (4 clips / shelf).
  - Bases shall be 24" deep & wall cabinets shall be 12" deep, unless otherwise noted.
  - Countertops shall be minimum 1 1/2" thick at front edge U.O.N.
  - Splashes shall be 1/2" thick X 4" high.
  - Cabinets abutting walls shall have scribes.
  - Colors selected by owner from standard stock.
  - Submit shop drawings to architect for review.
  - All cabinets not abutting walls shall have finished end panel. (F.E.P.).
  - Cabinets shall have minimum fillers at interior corners.
  - Toe kicks shall be 6" high marine plywood.

REVISIONS	BY

KUOPPALA & ASSOCIATES, P.A.  
ARCHITECTS  
FLORIDA ARCHITECT #9481  
925 SOUTH MILITARY TRAIL, SUITE D-10  
WEST PALM BEACH, FLORIDA 33415  
(561) 682-1009

STATE OF FLORIDA  
REGISTERED ARCHITECT  
ROBERT E. KUOPPALA  
AR9481